



CUSTOMER INPUT CONNECTIONS
 120/208VAC 3PH 4W 60HZ
 1600A, 100% RATED COPPER BUS

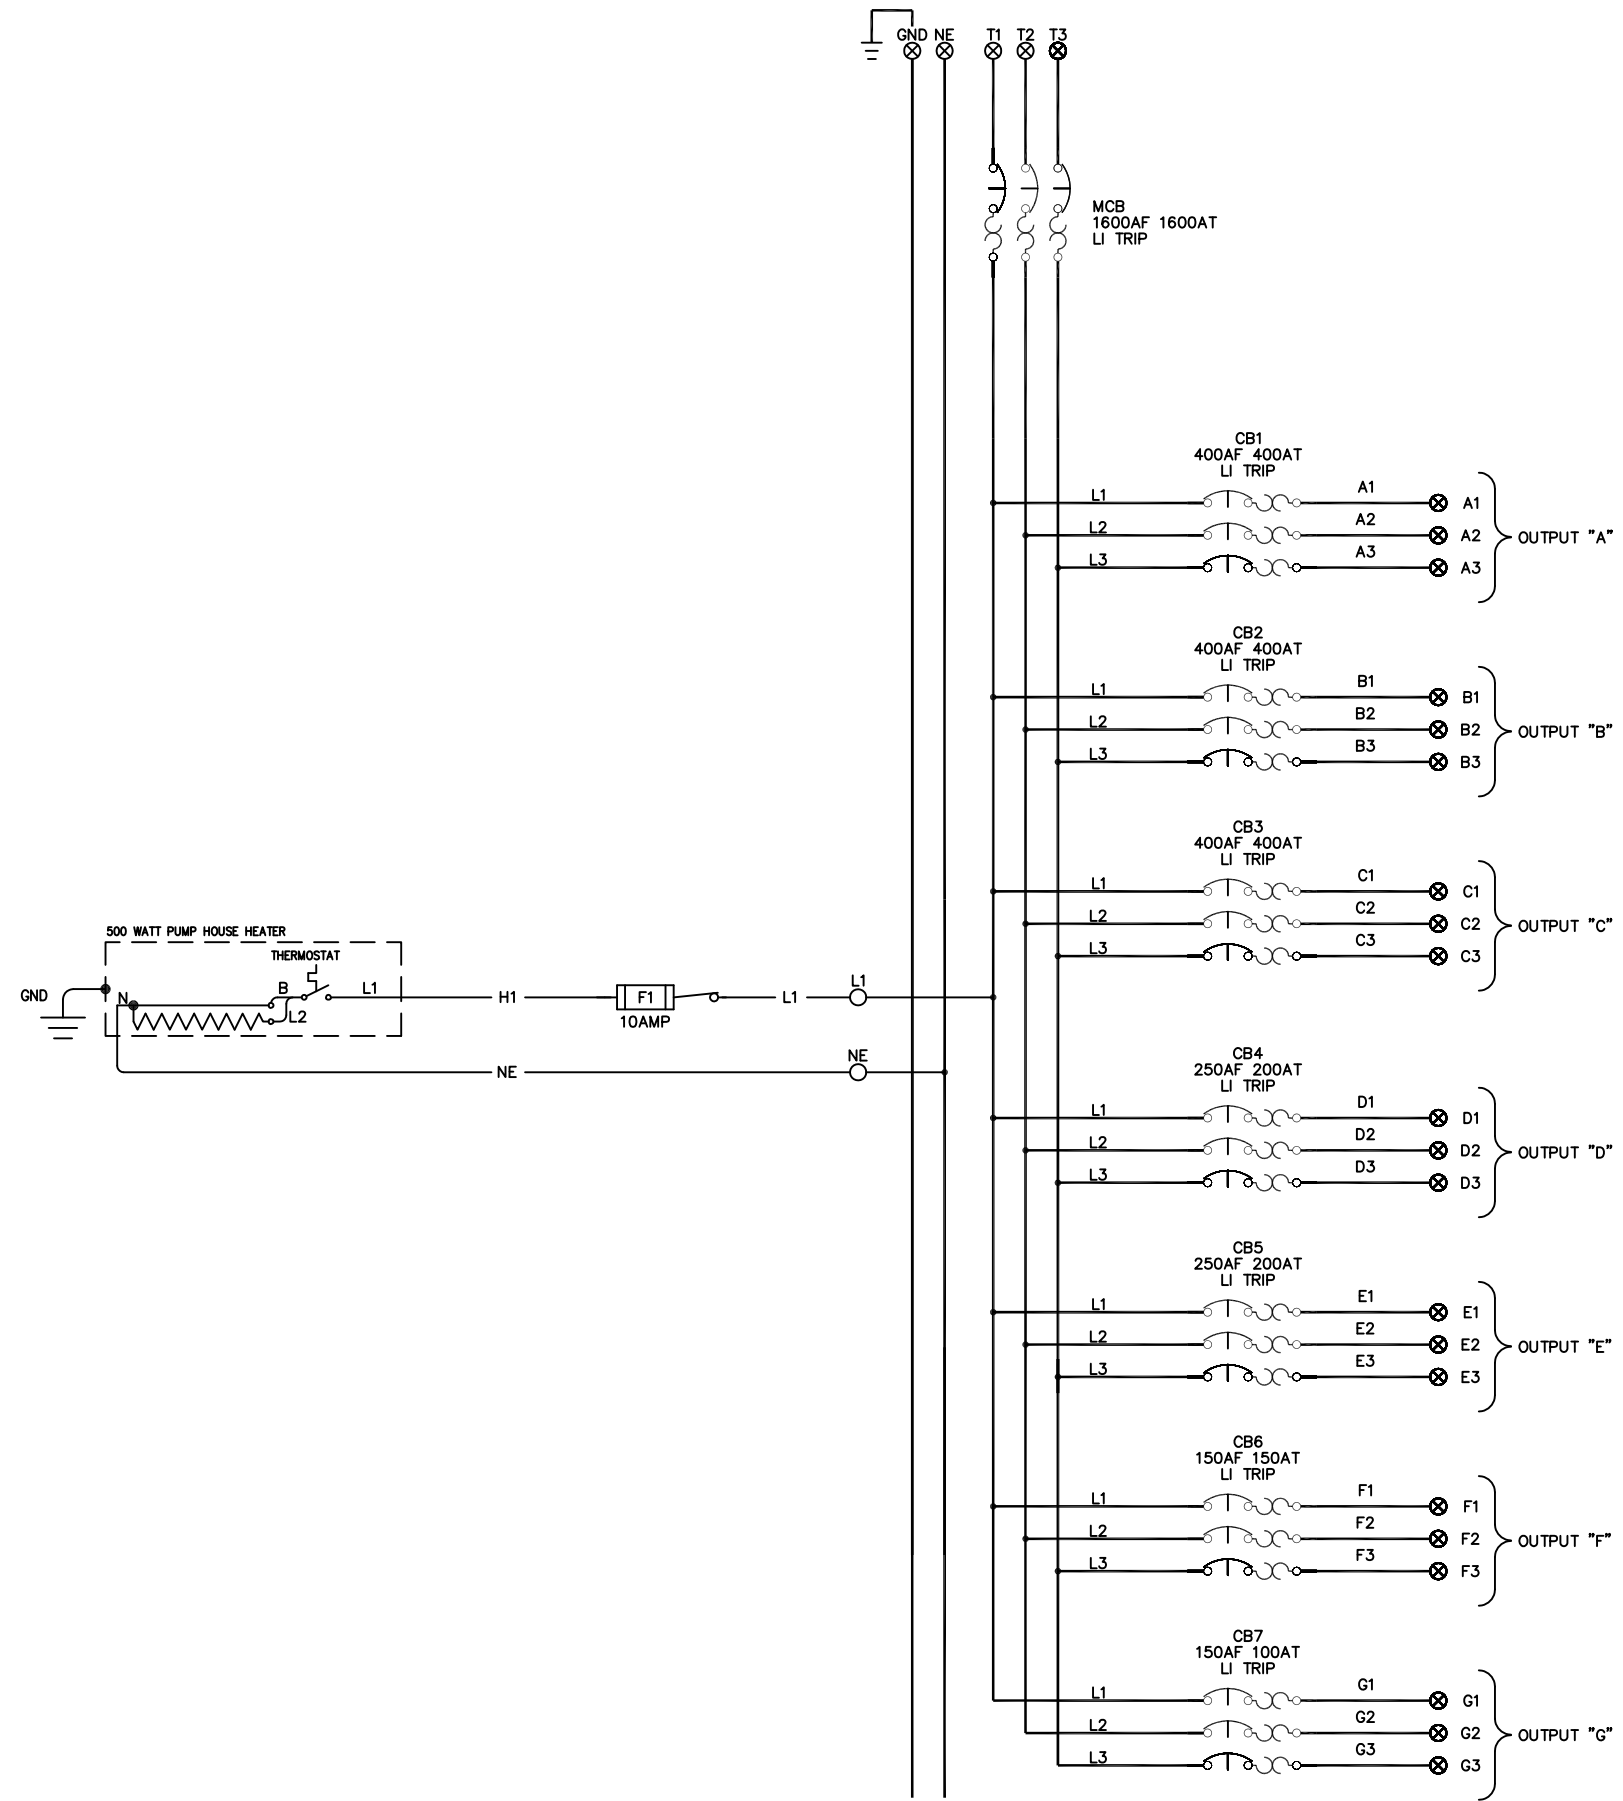

NOTES

- 1) RELAY & TIMER CONTACTS LOCATION:
 (LINE # = LOCATED IN DC SCHEMATIC)
 (WIRE #'S = LOCATED IN AC SCHEMATIC)
- 2) NOMENCLATURE DESCRIPTIONS, IF NOT ON THIS DRAWING (REFER TO LAKE SHORE STANDARD NOMENCLATURE - ES103)
- 3) COMPONENT LOCATION MARKER, USED WHEN LOCATED IN A DIFFERENT SECTION:
 (O = LOCATED OUTSIDE OF SECTION)
- 4) CUSTOMER CONNECTION TERMINAL BLOCK (TB1)
- 5) CUSTOMER CONNECTION TERMINAL BLOCK (LOCATED ON PC BOARD OR BLACK BOX)
- 6) LAKE SHORE CONNECTION TERMINAL BLOCK (TB2 OR TB3)
- 7) LAKE SHORE CONNECTION TERMINAL BLOCK (LOCATED ON PC BOARD OR BLACK BOX)
- 8) LAKE SHORE SEC. TO SEC. TERMINAL BLOCK (TB4)
- 9) LAKE SHORE SEC. TO SEC. TERMINAL BLOCK (LOCATED ON PC BOARD OR BLACK BOX)
- 10) CUSTOMER ENGINE TERMINAL BLOCK (ETB)
- 11) CUSTOMER WIRING
- 12) CUSTOMER CABLING
- 13) CUSTOMER SUPPLIED EQUIPMENT

-	-	-	-	-
-	-	-	-	-
-	-	-	-	-
REV	DESCRIPTION	BY	APV	DATE
 LAKE SHORE ELECTRIC Corp BEDFORD, OHIO U.S.A.				
1600A SWITCHBOARD AC SCHEMATIC				
SCALE: NONE	DRN: --- --/--/--	CHK: --- --/--/--	APV: --- --/--/--	
<small>THIS DOCUMENT IS THE PROPERTY OF Lake Shore Electric Corporation. UNDER COPYRIGHT LAW, DISTRIBUTION AND REPRODUCTION OF THIS DOCUMENT, IN WHOLE OR IN PART, IS PROHIBITED WITHOUT PRIOR WRITTEN PERMISSION FROM Lake Shore Electric Corporation.</small>				
PROJ: - -				
CUSTOMER:		DWG NUMBER		
-		XX2-XXXX-03		-
-		QUOTE/JOB#:	PG 1 OF 1	
-				